

CITY OF EDMONTON PROPOSED STANDARDS FOR CRITICAL SWALES

SPLIT / FRONT TO BACK DRAINAGE

BACK OF THE LOT

STANDARD SPLIT DRAINAGE

FRONT TO BACK DRAINAGE


WALK OUT BASEMENT

AROUND BUILDING


2M @ 10% MIN. SLOPE
OR MIN. 0.15M DROP
IF LESS THAN 1.5 M
FROM WALL TO
PROPERTY LINE

REAR SWALE


DRAINAGE MAY BE
SPLIT FROM CENTRE
OR ALL SLOPED TO
LOW SIDE.
(TYPICAL 1.5% MIN.
CROSS YARD SLOPE)

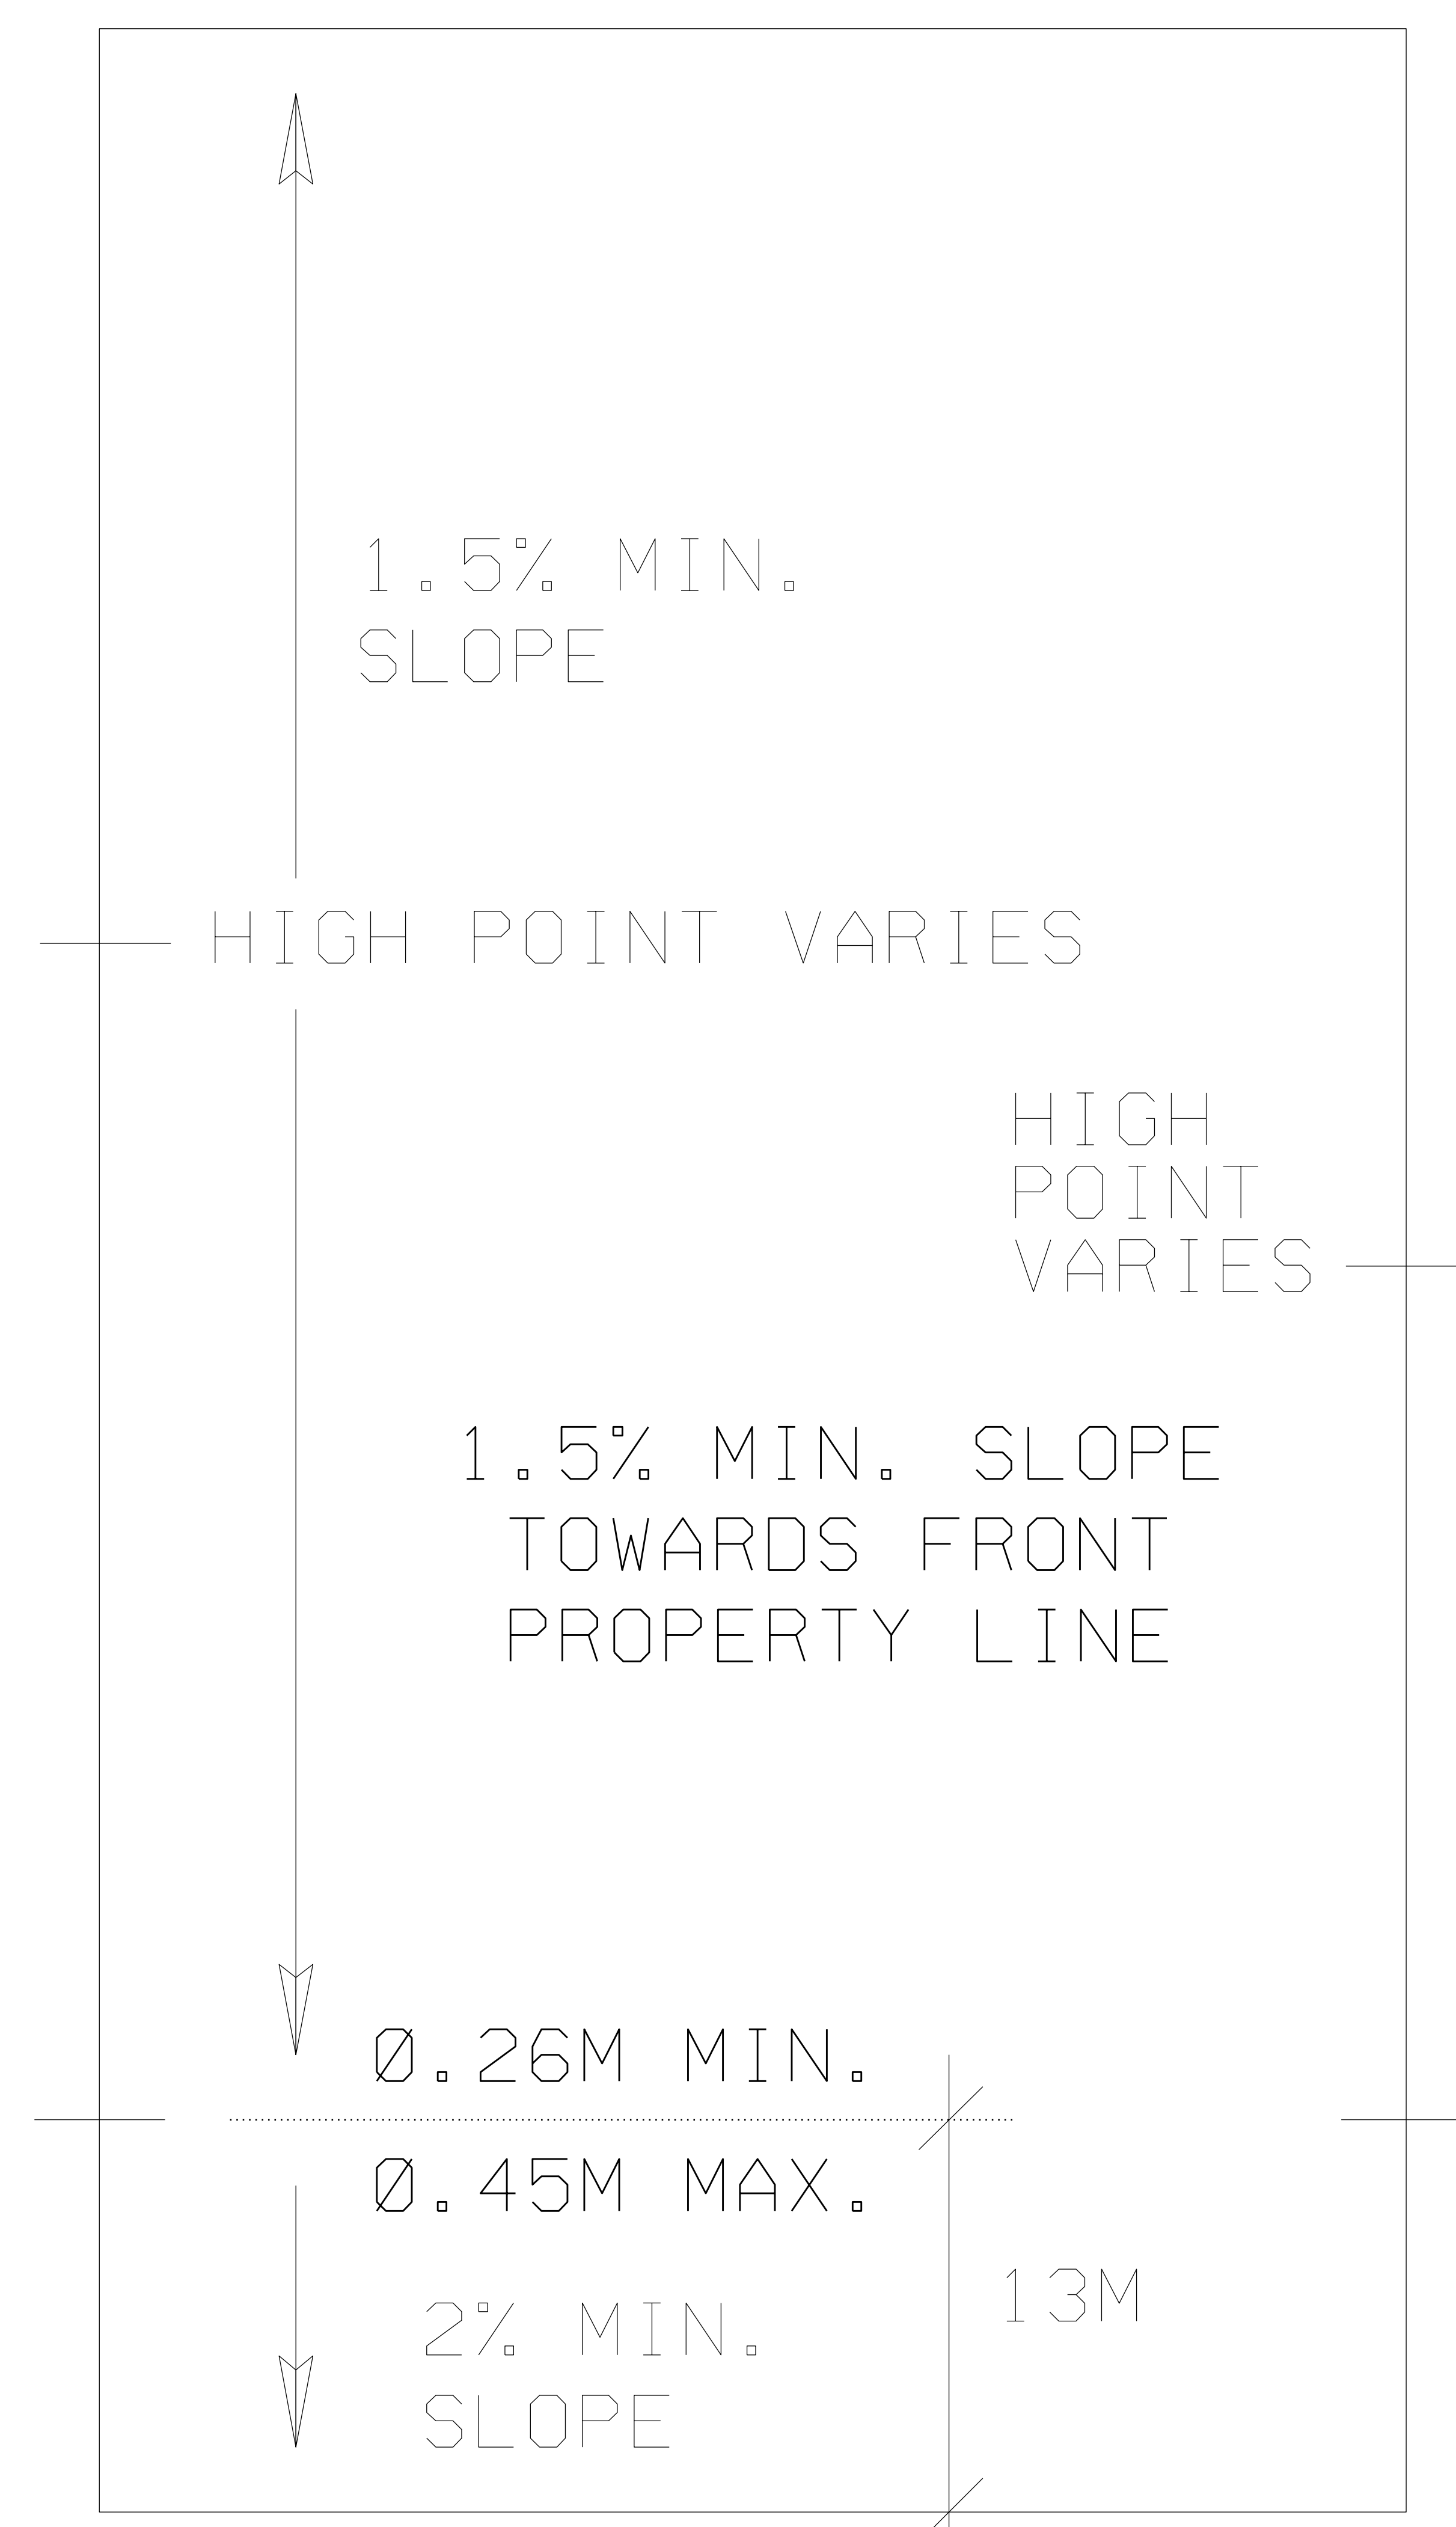

TYPE D

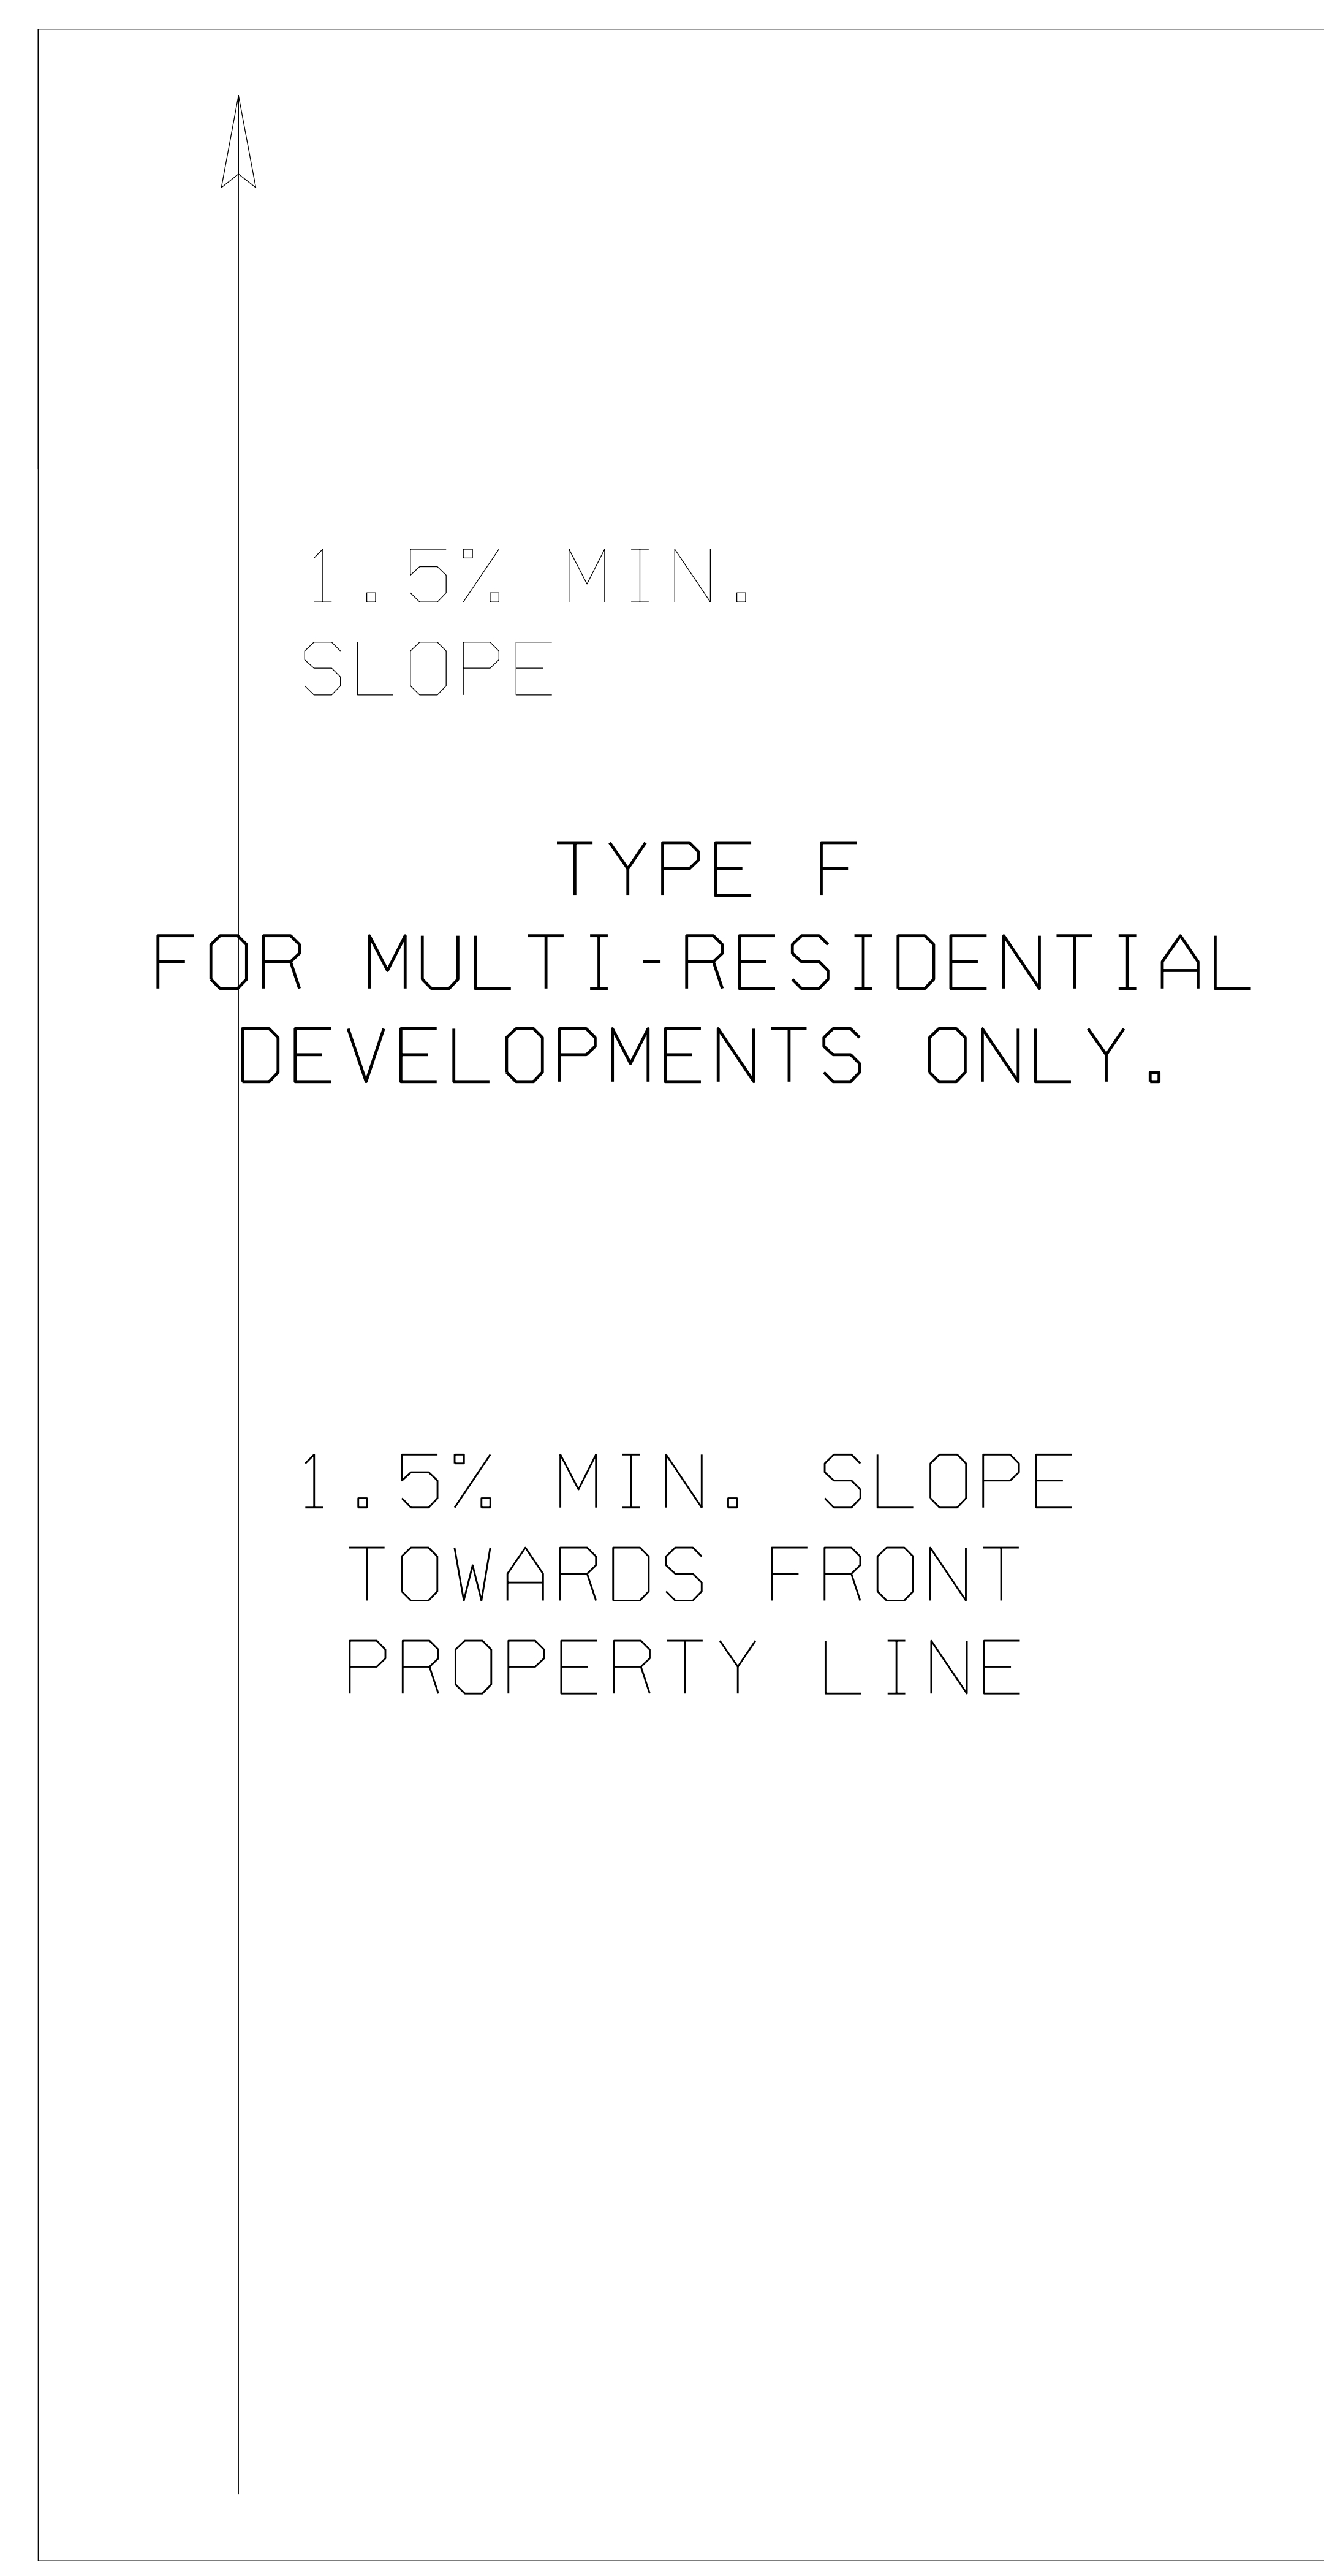

TYPE F

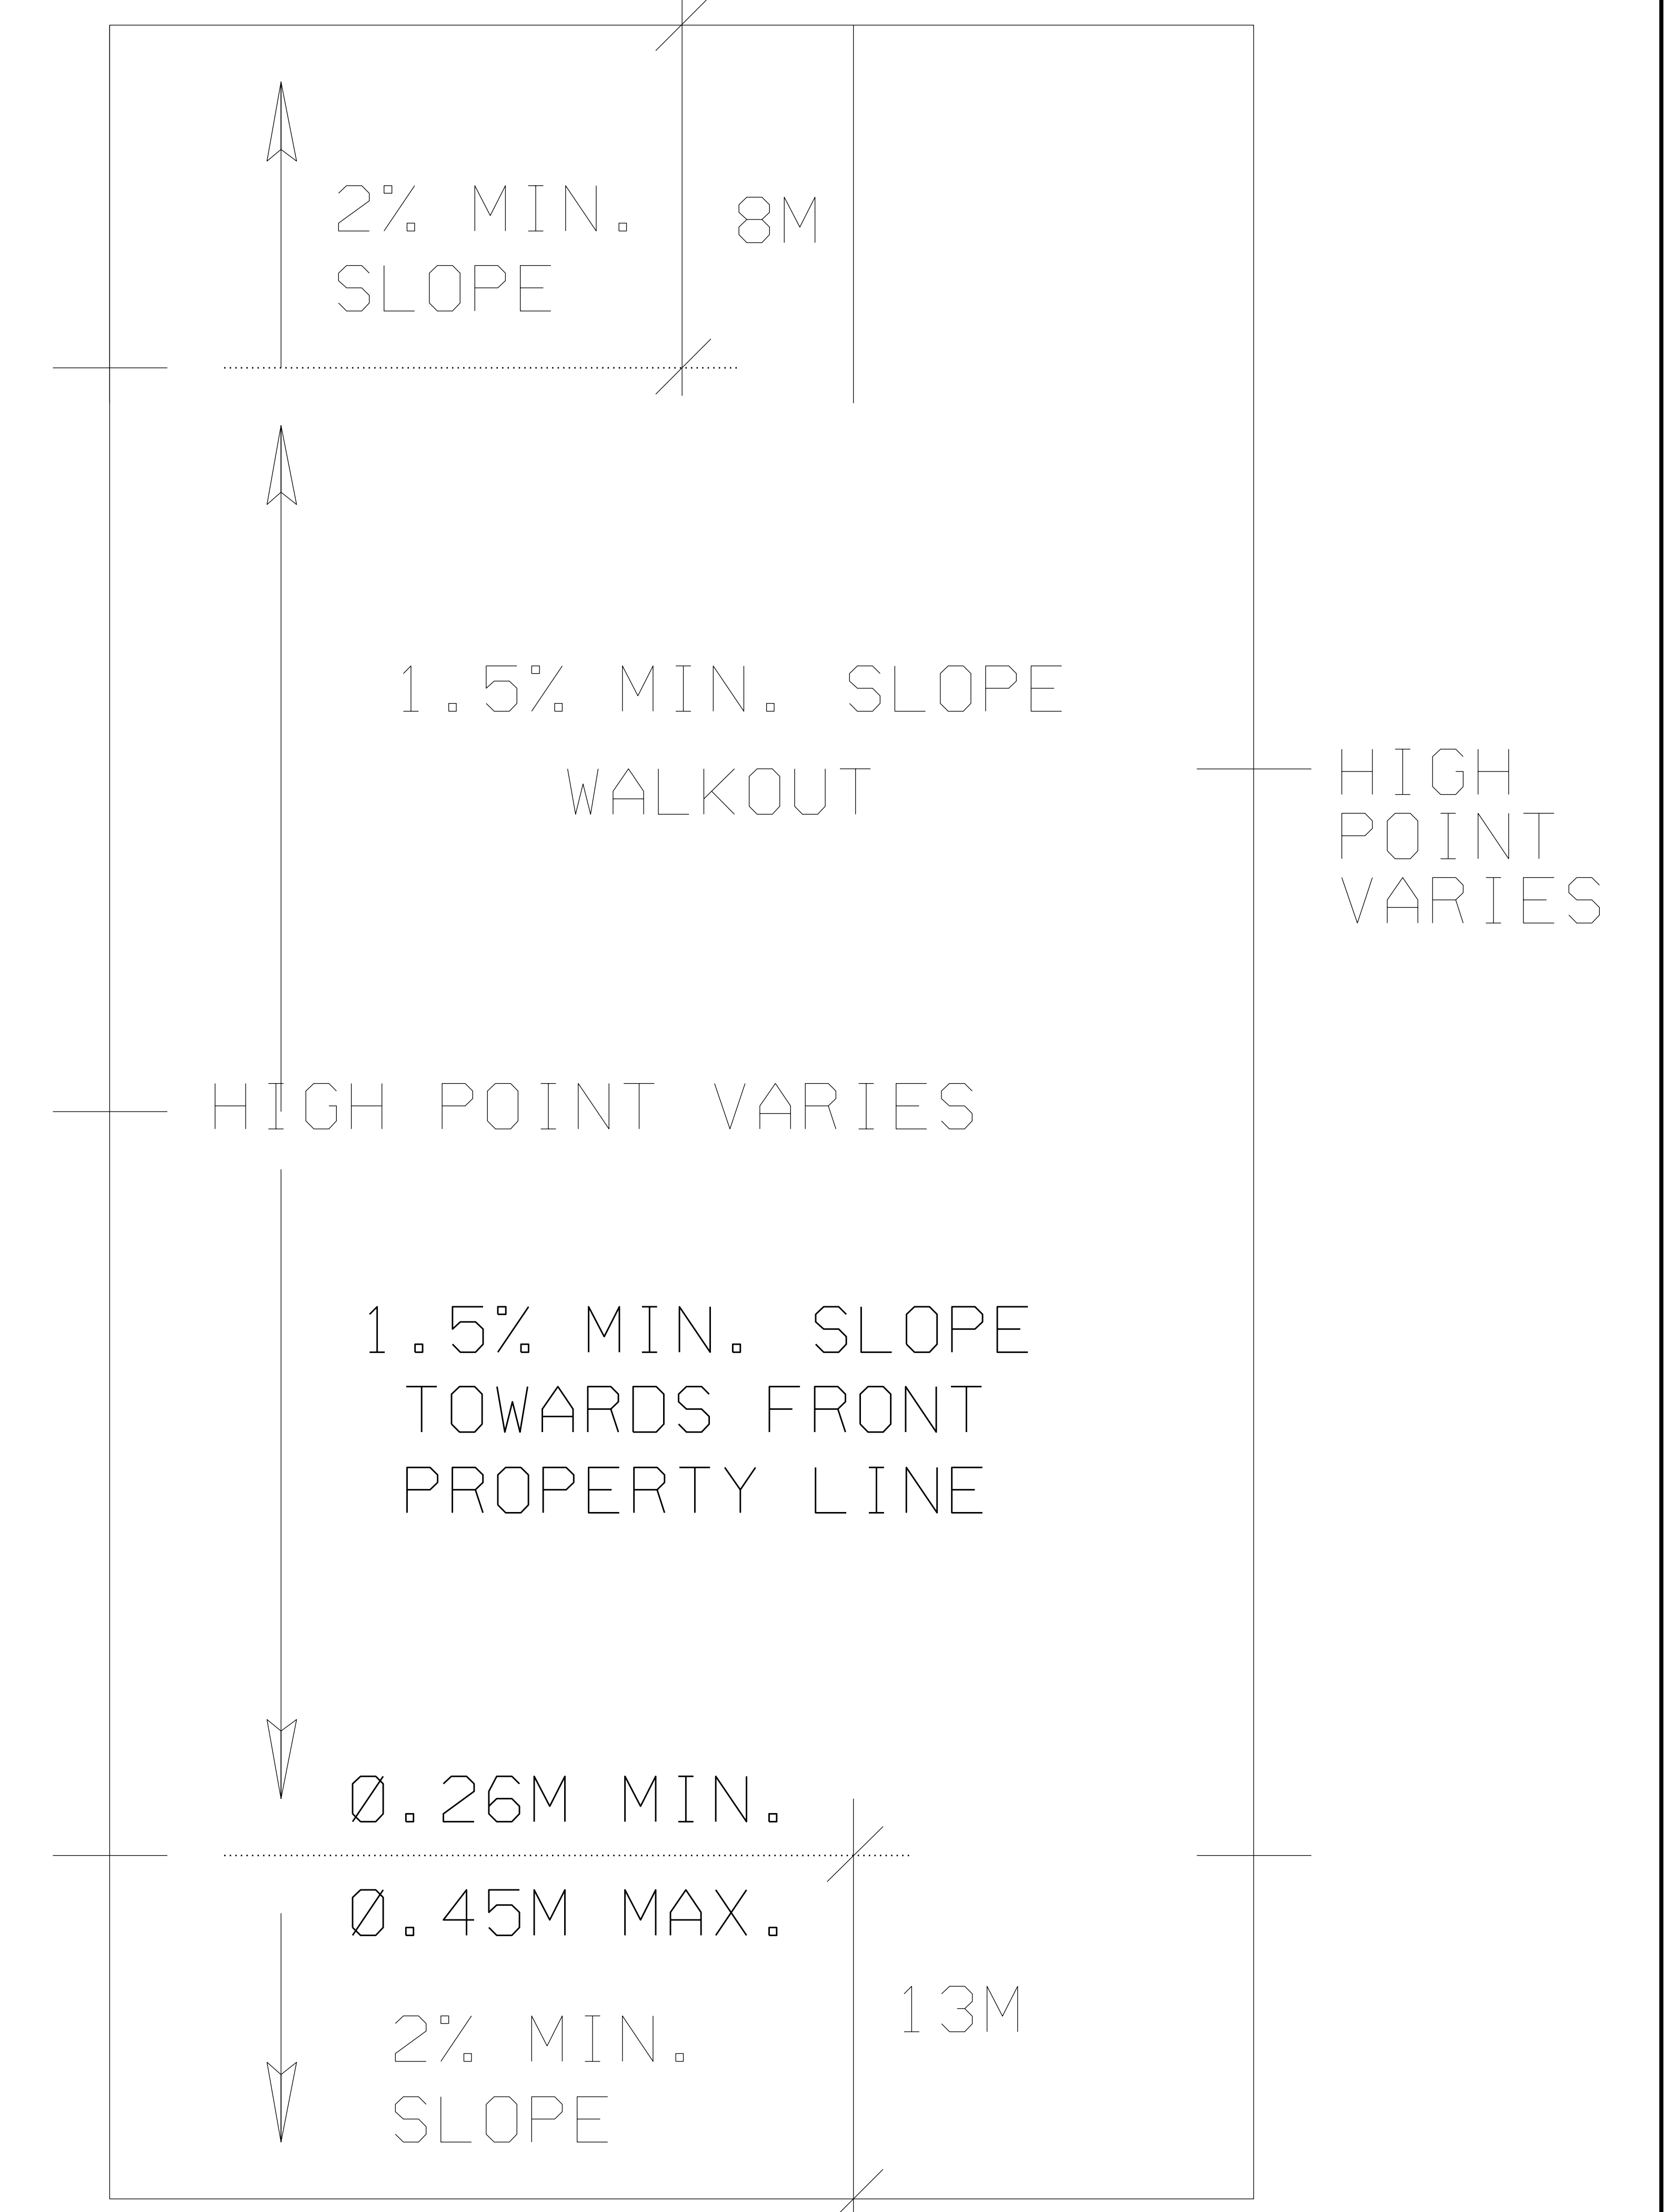

DATE: SEPTEMBER 2017
TYPE W

FRONT OF THE LOT